


ifm electronic



Operating instructions
ClassicLine module

AS interface

AC5203 / AC5205

AC5208 / AC5211


AC5213 / AC5214

AC5215 / AC5233

AC5294

UK

80226775/00 02/2015

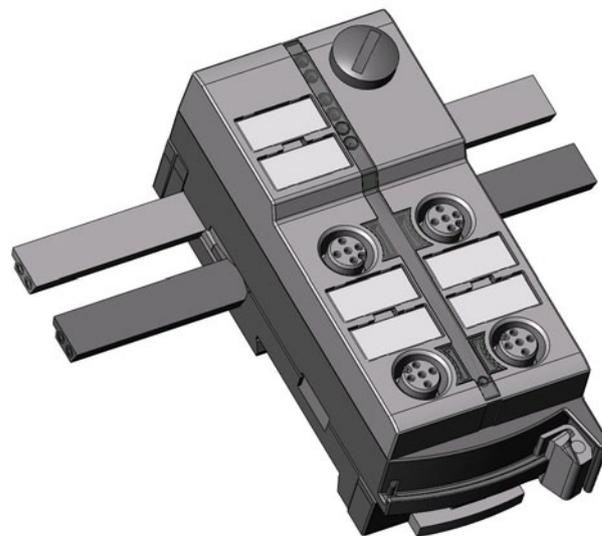

Contents

1 Preliminary note.....	3
2 Safety instructions	3
3 Functions and features	3
4 Installation.....	4
5 Operating and display elements	9
6 Addressing.....	9
6.1 Addressing with the AC1154 addressing unit.....	9
7 Electrical connection.....	14
8 Operation	15
9 Technical data.....	15

1 Preliminary note

- An instruction is indicated by „►“:
Example: ► Mount the unit as shown.
- A reaction to the action is indicated by „>“:
Example: > yellow LED lights.



Important note

Non-compliance can result in malfunction or interference.



Information

Supplementary note.

UK

2 Safety instructions

- Please read the operating instructions prior to set-up of the device. Ensure that the product is suitable for your application without any restrictions.
- The unit conforms to the relevant regulations and EC directives.
- Improper or non-intended use may lead to malfunctions of the unit or to unwanted effects in your application.
- Installation, electrical connection, set-up, operation and maintenance of the unit must only be carried out by qualified personnel authorised by the machine operator.


3 Functions and features

- maximum number of modules per master:
 - 31 (AC5205, AC5208, AC5211, AC5213)
 - 62 (AC5203, AC5214, AC5215, AC5233, AC5294)
- AS-interface version 3.0, downward compatible

4 Installation




▶ Disconnect the system from power before installation.

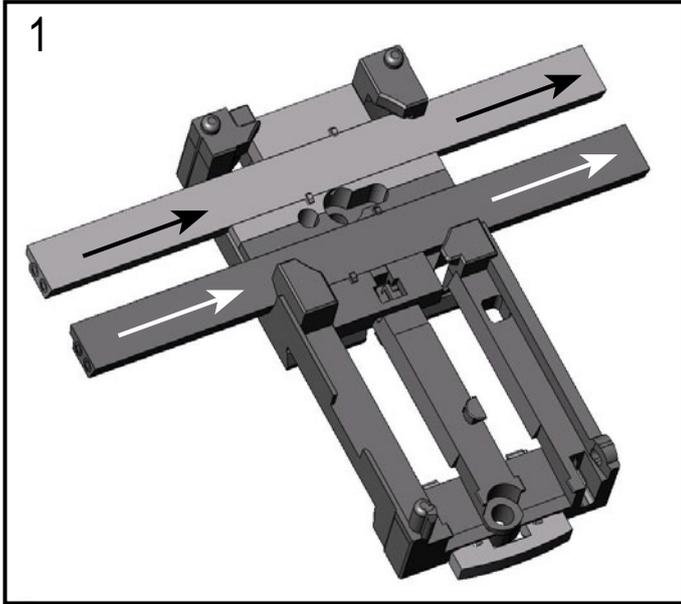


Alignment of the flat cable on delivery


Carefully place the yellow and optionally the black AS-i flat cable into the profile slot.

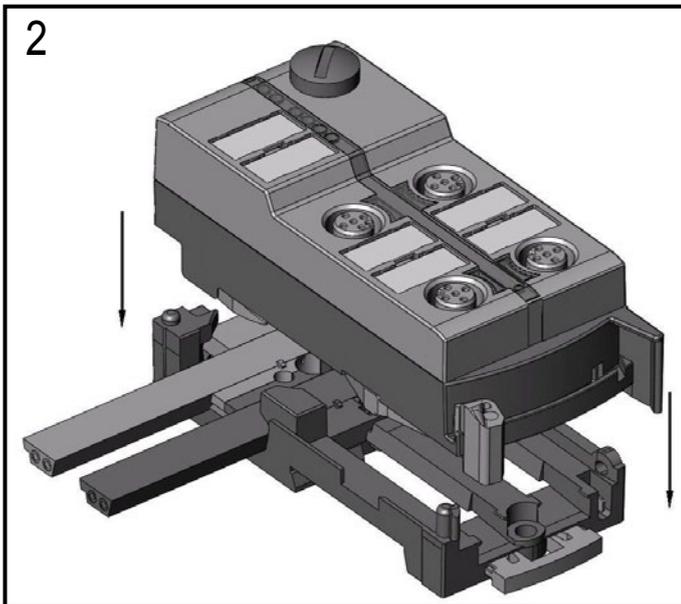

Mount the upper part.

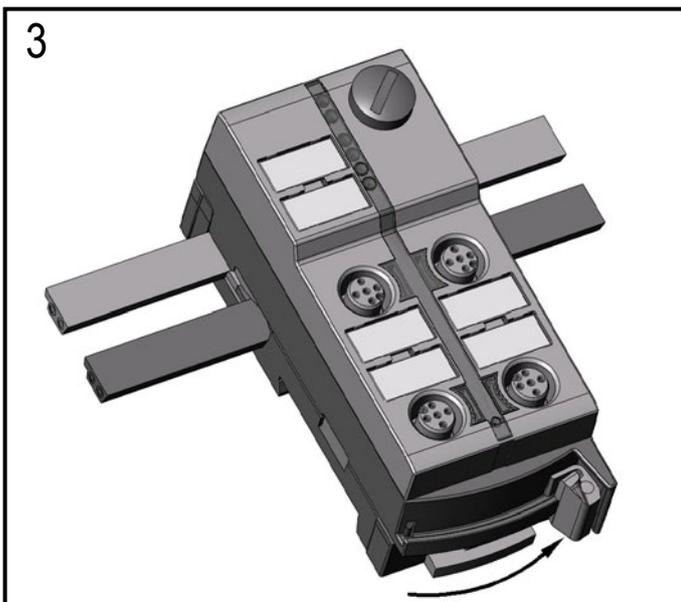



Lock the unit.

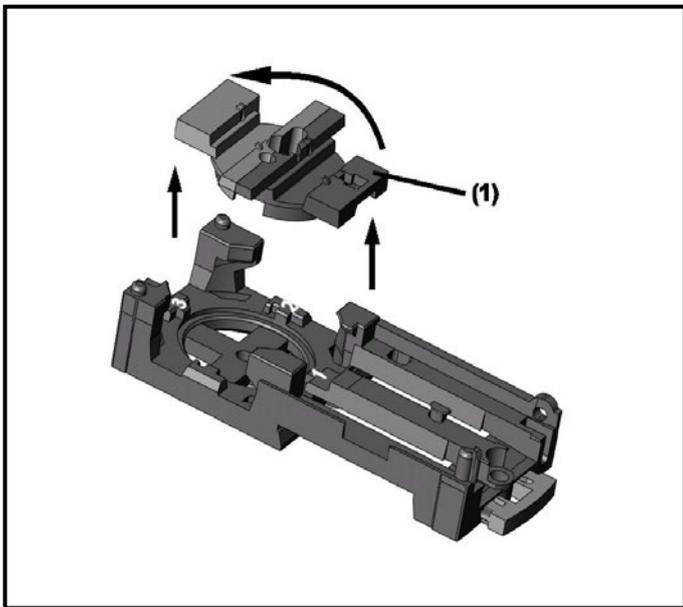

With the supplied lower part the flat cable can be aligned in three directions.

For the requested direction place the flat cable guide (1) accordingly.


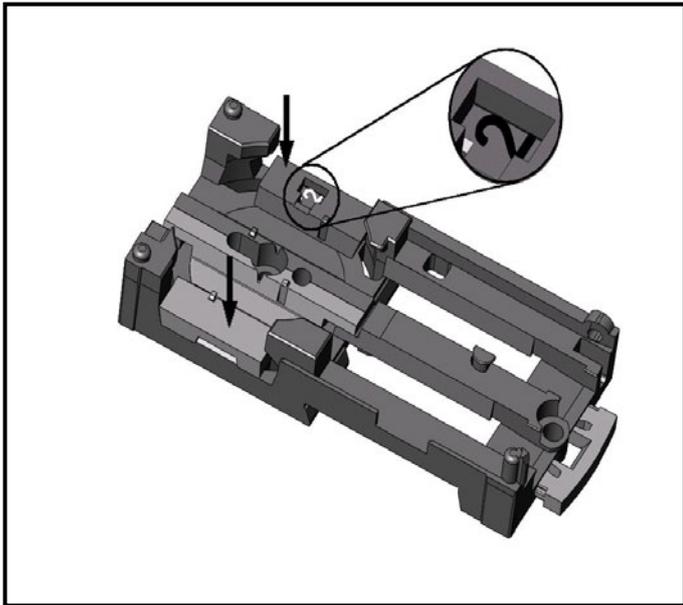


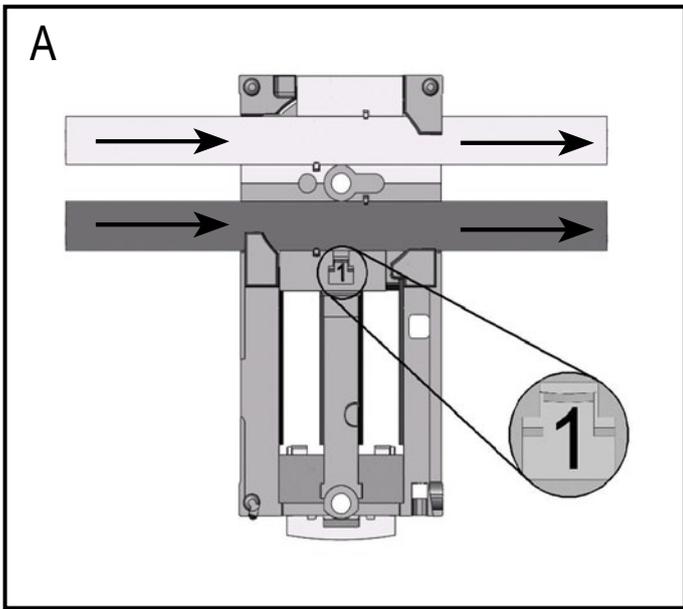


Settings at the lower part

Select the position 1, 2 or 3 depending on the requested flat cable alignment (→).

A = factory setting

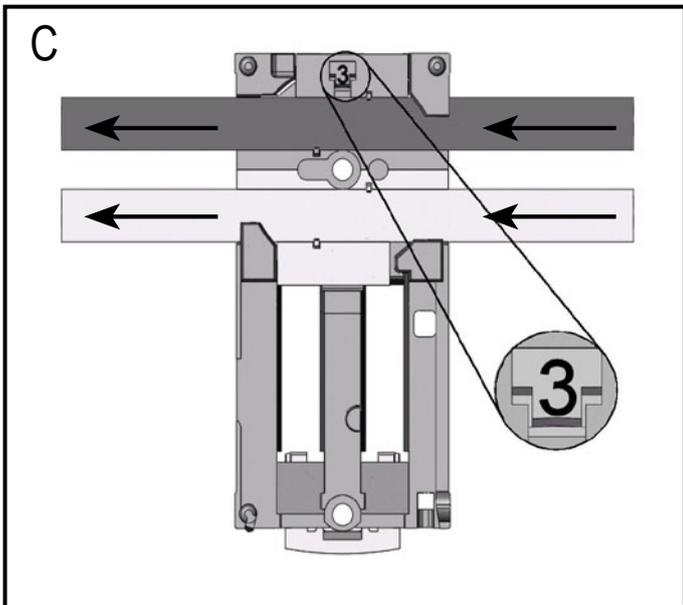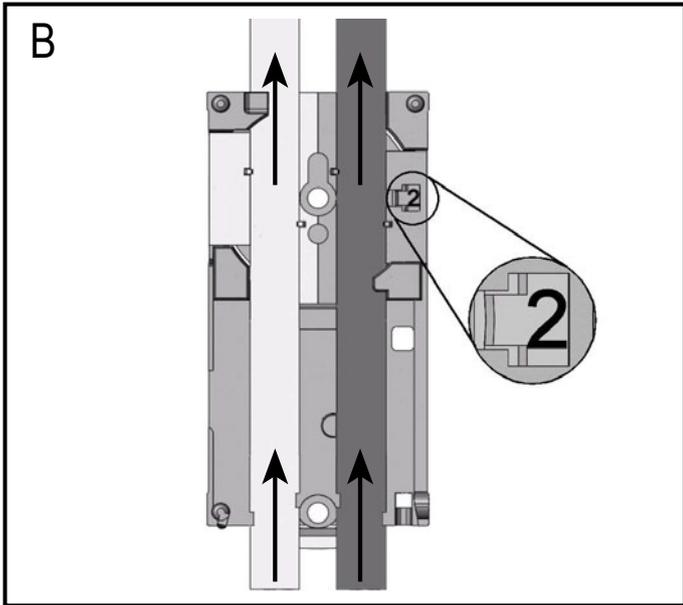


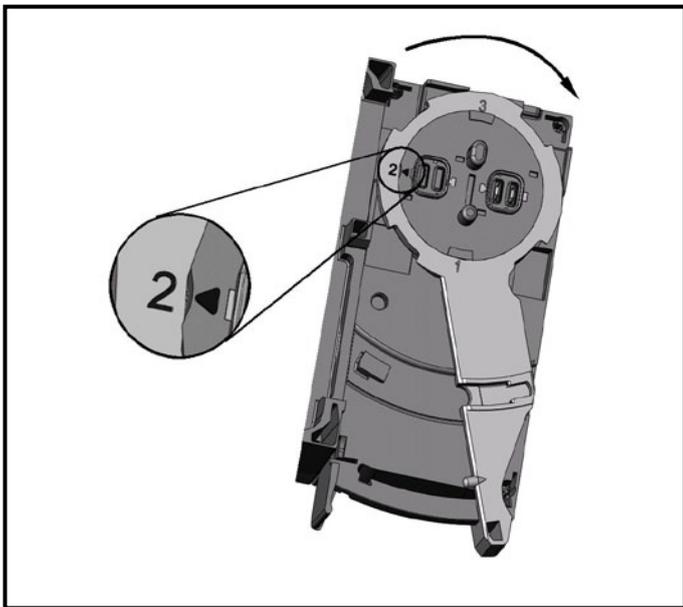


Settings at the upper part

Then set the selected position at the upper part. To do so, turn the triangle to the corresponding number (fig. D1 and D2).

UK

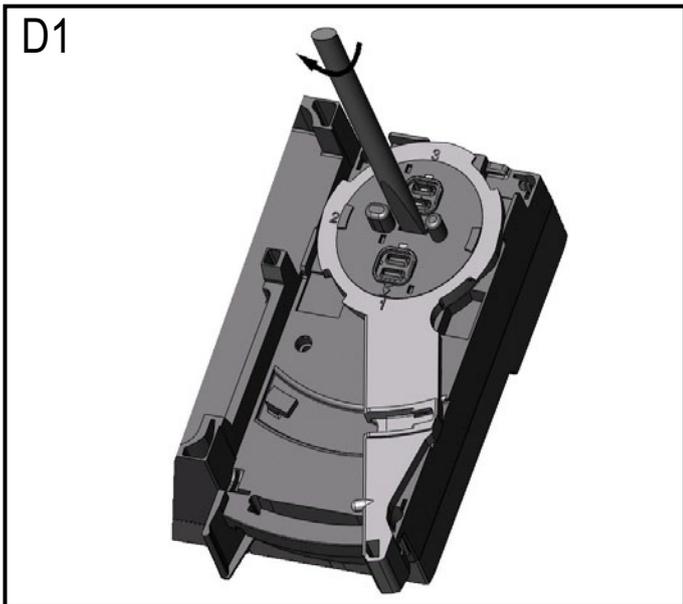



Use a tool, e.g. a screwdriver (figure D1) or the yellow / black flat cable guide (figure D2).

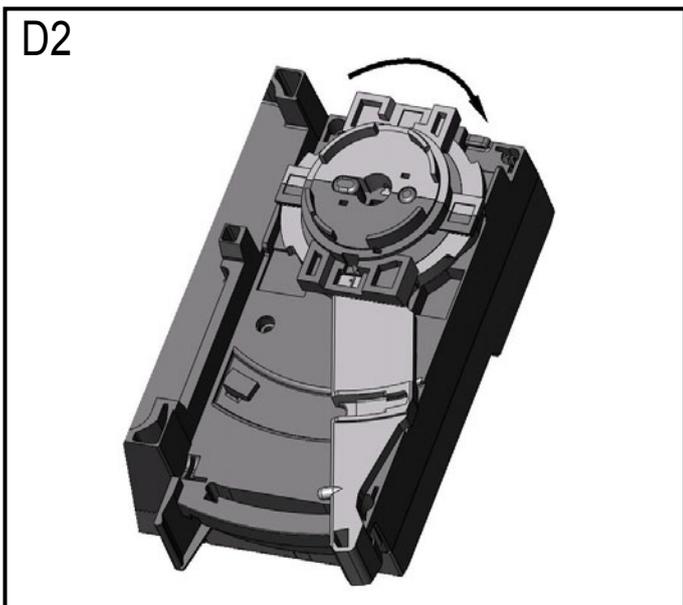

Open the unit




Open the unit using a tool as shown (e.g. screwdriver).

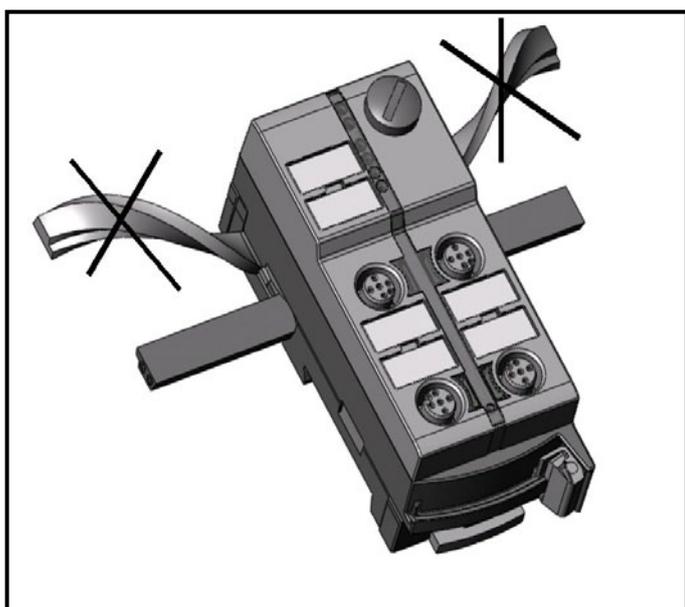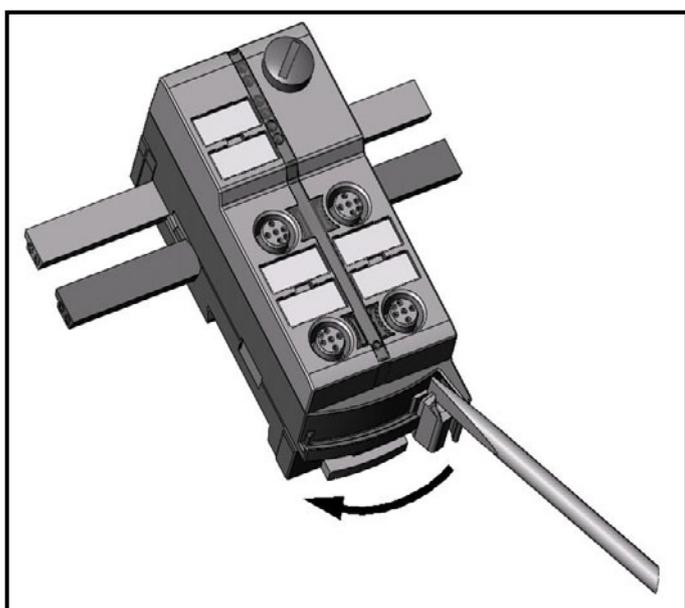

Take care in laying the AS-i flat cable, the flat cable should be laid straight for about 15 cm.

5 Operating and display elements

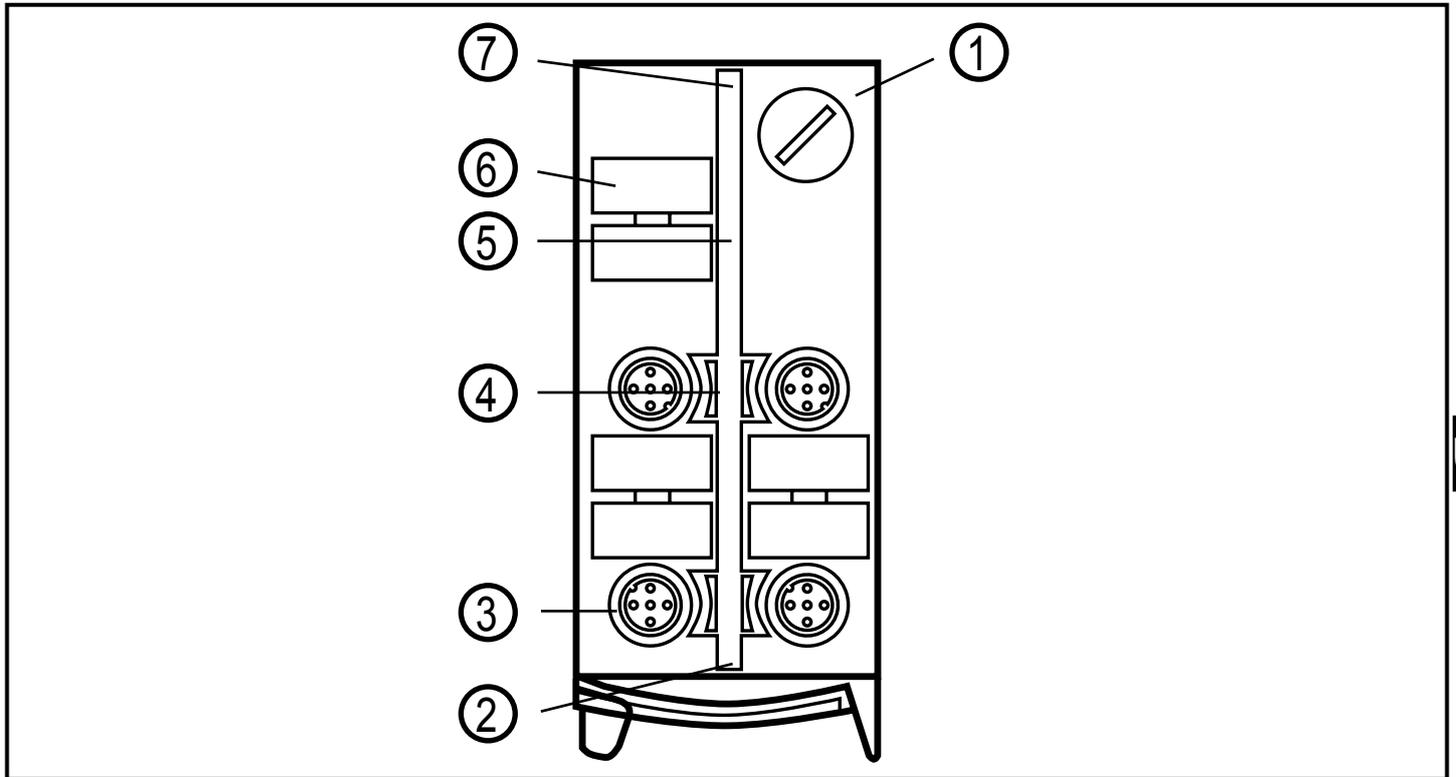

- 1: addressing interface
- 2: LED AUX
- 3: 4 M12 sockets
- 4: LED 2
- 5: LED 1
- 6: labels
- 7: LED PWR

6 Addressing

The address is set to 0 at the factory.

6.1 Addressing with the AC1154 addressing unit

When mounted and wired the module can be addressed with the addressing cable (E70213) via the integrated addressing interface.

If a slave with the extended addressing mode (AC5203, AC5214, AC5215, AC5233, AC5294) is used in combination with a master of the first generation (version 2.0), the parameter P3 must be 1 and the output bit D3 must be 0*. The output bit D3 and the parameter bit P3 must not be used.

* * default setting

If a slave with the extended addressing mode is used in combination with a master of the first generation (version 2.0), an address between 1A and 31A must be assigned to this slave.


AC5203

3 outputs

AS-i profile S-8.A.E / extended addressing mode: yes

Data bit	D0	D1	D2	D3
Output	1	2	3	-
Socket	O-1/2	O-1/2 O-2	O-3	-

Y-circuit outputs

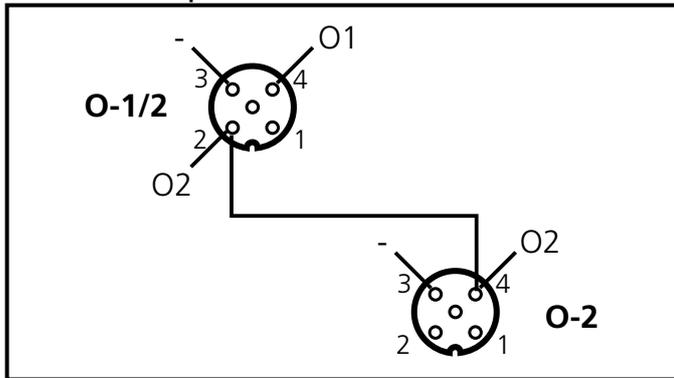


AC5205

4 inputs

AS-i profile S-0.0.E / extended addressing mode: no

Data bit	D0	D1	D2	D3
Input	I1	I2	I3	I4
Socket	I-1	I-2	I-3	I-4

Inputs

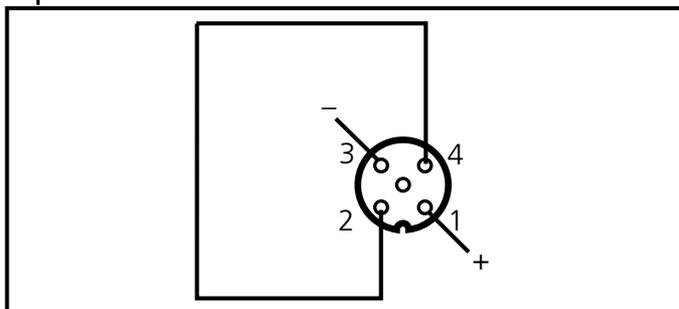


AC5208

4 outputs

AS-i profile S-8.0.E / extended addressing mode: no

Data bit	D0	D1	D2	D3
Output	O1	O2	O3	O4
Socket	O-1/2	O-1/2 O-2	O-3/4	O-3/4 O-4

Y-circuit outputs

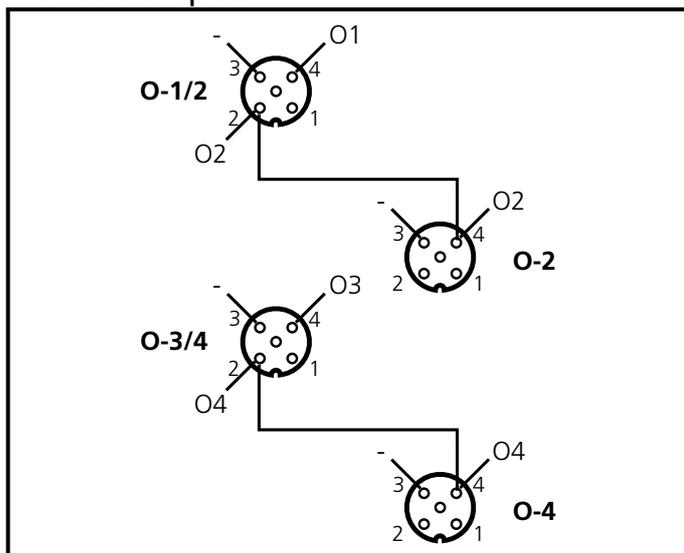

UK


AC5211

2 inputs / 2 outputs (2 Ampère)


AS-i profile S-3.0.E / extended addressing mode: no

Data bit	D0	D1	D2	D3
Input	I1	I2	-	-
Socket	I-1	I-2	-	-
Output	-	-	O3	O4
Socket	-	-	O-3/4	O-3/4 O-4

Inputs

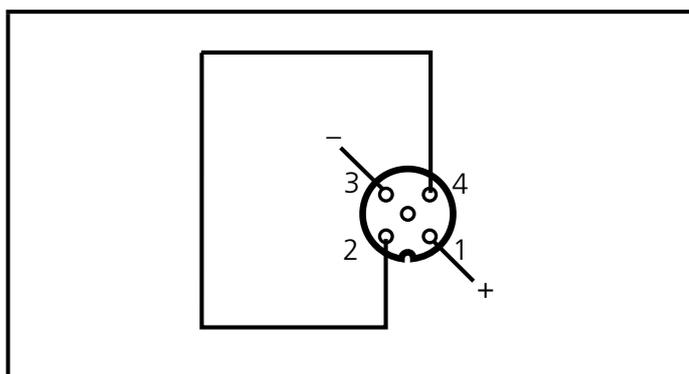

Y-circuit outputs

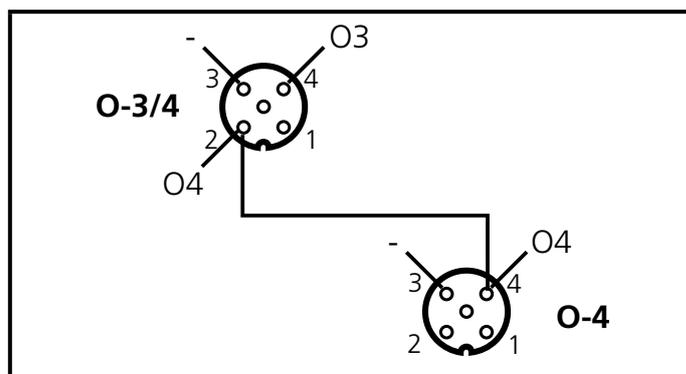


AC5213

4 outputs (2 Ampère)

AS-i profile S-8.0.E / extended addressing mode: no

Data bit	D0		D1		D2		D3	
Output	O1		O2		O3		O4	
Socket	O-1/2	O-1/2	O-2	O-3/4	O-3/4	O-4	O-4	

Y-circuit outputs

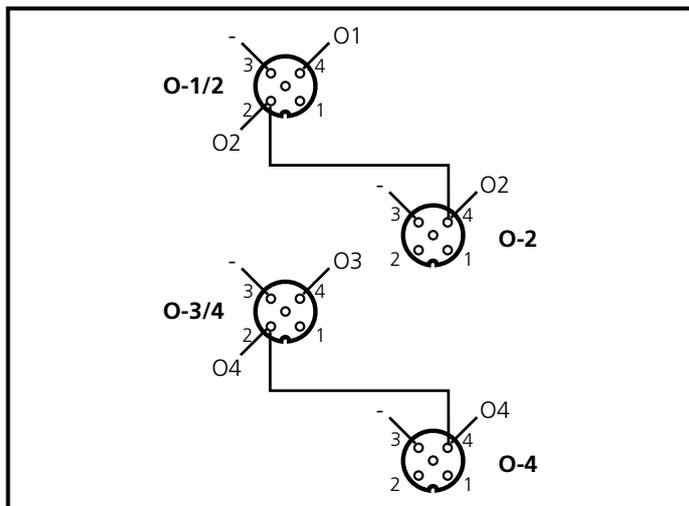

AC5214


2 outputs / 2 inputs

AS-i profile S-B.A.E / extended addressing mode: yes


Data bit	D0		D1		D2		D3	
Input	-		-		I3		I4	
Socket	-		-		I-3/4		I-3/4 I-4	

Output	O1		O2		-		-	
Socket	O-1/2		O-1/2 O-2		-		-	

Y-circuit inputs

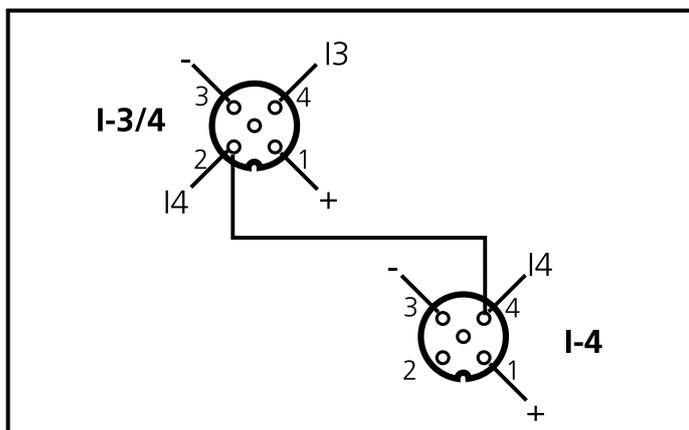

Y-circuit outputs

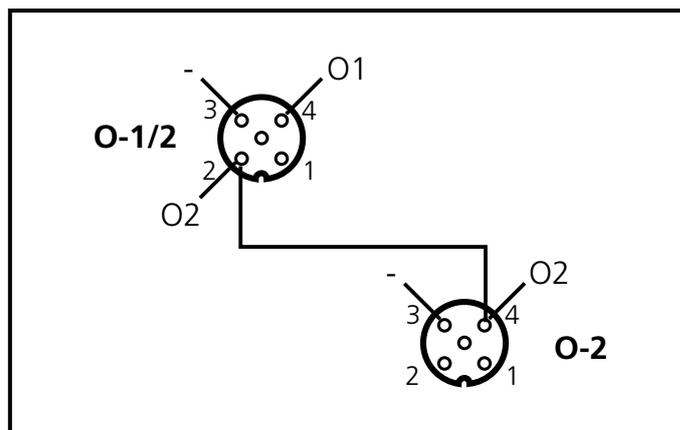


AC5215

4 inputs

AS-i profile S-0.A.E / extended addressing mode: yes

Data bit	D0		D1		D2		D3	
Input	I1		I2		I3		I4	
Socket	I-1/2		I-1/2	I-2	I-3/4		I-3/4	I-4

Y-circuit inputs

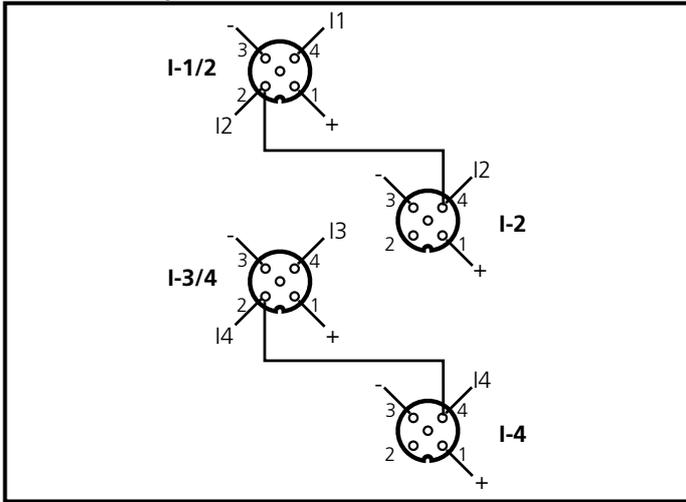

UK


AC5233

4 outputs (2 Ampère)

AS-i profile S-7.A.7 / extended addressing mode: yes

Data bit	D0		D1		D2		D3	
Output	O1		O2		O3		O4	
Socket	O-1/2		O-1/2	O-2	O-3/4		O-3/4	O-4

Y-circuit outputs

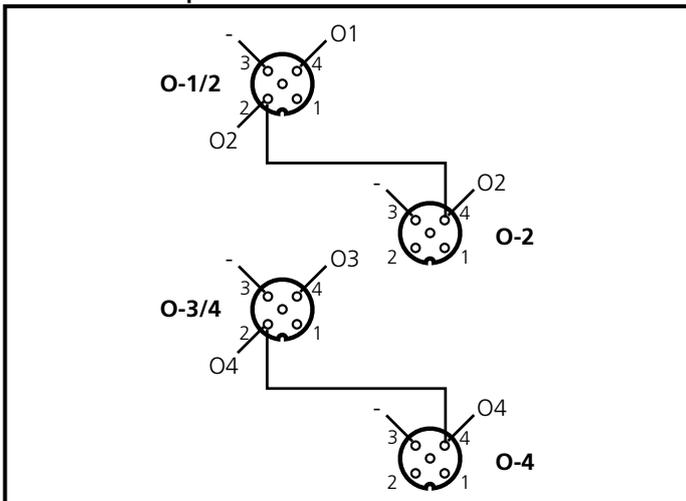


AC5294

4 inputs

AS-i profile S-0.A.E / extended addressing mode: yes

Data bit	D0	D1	D2	D3
Input	I1	I2	I3	I4
Socket	I-1	I-2	I-3	I-4

Inputs

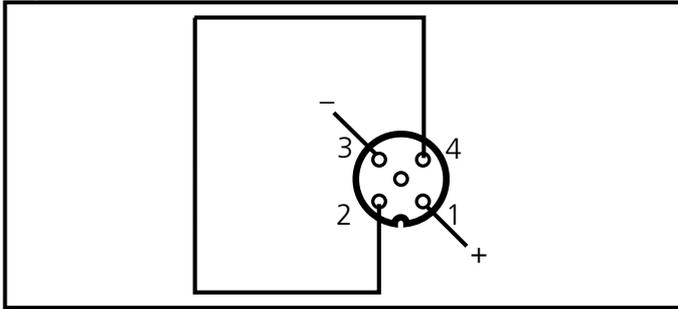

7 Electrical connection



The unit must be connected by a qualified electrician.

The national and international regulations for the installation of electrical equipment must be adhered to.

- ▶ Disconnect power.
- ▶ Connect the unit.

Connect the plugs of the sensors / actuators to the M12 sockets, tightening torque 0.6...0.8 Nm. Cover the unused sockets with protective caps (E73004)*, the addressing socket with the supplied protective cap. Tightening torque 0.6...0.8 Nm.

To guarantee protection rating IP 67 you also have to

- use the flat cable end seal (E70413)* if the module is at the end of the cable line

* to be ordered separately

8 Operation



Avoid build-up of dirt and dust on the upper and lower parts so that the locking mechanism is not affected.

- LED 2 yellow: input / output switched
- LED PWR green: AS-i voltage supply ok
- LED AUX green: AUX voltage supply ok (AC5203, AC5208, AC5211, AC5213, AC5214, AC5233)
- LED FAULT red lights: AS-i communication error, slave does not participate in the „normal“ exchange of data, e.g. slave address 0
- LED FAULT red flashes: peripheral fault, e.g. sensor supply / output overloaded or shorted
- LED 1 yellow: logic state of the outputs



Overload and short circuit of the input supply and the outputs are signalled as peripheral fault to the AS-i master (version 2.1 or higher).

9 Technical data

Technical data and further information at www.ifm.com.