



Safety control unit SB4-OR-4CP




- Evaluation device for safety thru-beam sensors SLA12 and SLA29 and for 2 channel safety devices (emergency off)
- 4 sensor channels
- Self-monitoring (type 4 according to IEC/EN 61496-1)
- Operating mode can be selected by means of DIP switches
- Start/Restart disable
- Relay monitor
- Stability alarm indication
- Clearly visible LED functional display
- 7-segment diagnostic display
- Safety outputs OSSD, external status displays OSSD

Safety control unit



Dimensions

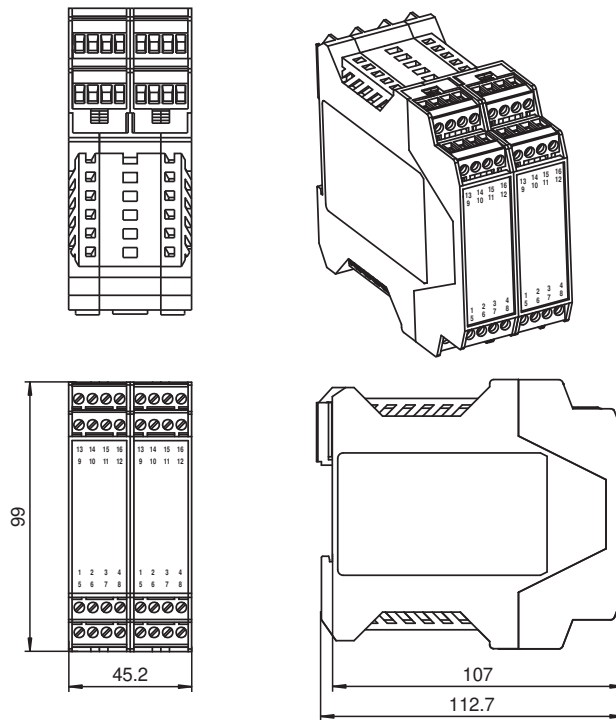

Technical Data

General specifications	
Operating mode	Start/restart disable, relay monitor,
Functional safety related parameters	
Safety Integrity Level (SIL)	SIL 3
Performance level (PL)	PL e
Category	Cat. 4
Mission Time (T _M)	20 a
PFH _d	3.5 E-9
B _{10d}	see instruction manuals

Release date: 2023-02-15 Date of issue: 2023-02-15 Filename: 180323_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0001
fa-info@us.pepperl-fuchs.com

Germany: +49 621 776 1111
fa-info@de.pepperl-fuchs.com

Singapore: +65 6779 9091
fa-info@sg.pepperl-fuchs.com

PEPPERL+FUCHS

Technical Data

Type	4	
Indicators/operating means		
Diagnostics indicator	7-segment display	
Function indicator	LED red: OSSD OFF LED green: OSSD ON Yellow LED: start readiness channel 1 - 4 LED yellow: switching state (receiver)	
Stability alarm indicator	LED yellow flashing: Indicator lamp channel 1 ... 4	
Electrical specifications		
Operating voltage	U_B	24 V DC, $\pm 20\%$
No-load supply current	I_0	max. 500 mA
Protection class	no identification ; see instruction manuals	
Input		
Activation current	approx. 7 mA	
Activation time	0.4 ... 1.2 s	
Test input	Reset-input for system test	
Output		
Safety output	2 relay outputs, force-guided NO-contact	
Signal output	Output for displaying the switching state of the OSSDs	
Switching voltage	10 V ... 250 V AC/DC	
Switching current	min. 10 mA , max. 6 A AC/DC	
Switching power	DC: max. 24 VA AC: max. 230 VA	
Response time	30 ms	
Conformity		
Functional safety	ISO 13849-1 ; EN 61508 part1-4	
Product standard	EN 61496-1	
Approvals and certificates		
CE conformity	CE	
UKCA conformity	UKCA	
UL approval	cULus	
TÜV approval	TÜV	
Ambient conditions		
Ambient temperature	0 ... 50 °C (32 ... 122 °F)	
Storage temperature	-20 ... 70 °C (-4 ... 158 °F)	
Relative humidity	max. 95 %, not condensing	
Shock resistance	see instruction manuals	
Vibration resistance	see instruction manuals	
Mechanical specifications		
Degree of protection	IP20	
Connection	screw terminals , lead cross section 0.2 ... 2 mm ²	
Material		
Housing	Polyamide (PA)	
Mass	320 g	


Release date: 2023-02-15 Date of issue: 2023-02-15 Filename: 180323_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.comUSA: +1 330 486 0001
fa-info@us.pepperl-fuchs.comGermany: +49 621 776 1111
fa-info@de.pepperl-fuchs.comSingapore: +65 6779 9091
fa-info@sg.pepperl-fuchs.com

PEPPERL+FUCHS

Connection

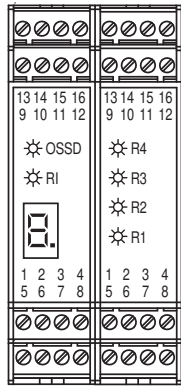

Slot 1 Slot 2

Terminal Slot 1

Terminal	Function
1	Reset input; normally closed contact
2	Restart input (RI); normally closed contact
3	24 V DC connection for reset, restart and RM
4	Relay monitor (RM)
5 - 6	OSSD1; potential free relay contact; normally open contact
7 - 8	OSSD2; potential free relay contact; normally open contact
9	Signal output OSSD OFF
10	Signal output OSSD ON
11	Signal output restart
12	Leave free (n.c.)
13	+24 V DC supply voltage
14	0 V DC supply voltage
15	Earth
16	Leave free (n.c.)

Terminal Slot 2

Terminal	Function	Channel assignment
1	Receiver 2 input	Channel 2
2	Receiver 2 +U	
3	Transmitter 2 +U	
4	Transmitter 2 output	Output
5	Receiver 1 input	Channel 1
6	Receiver 1 +U	
7	Transmitter 1 +U	
8	Transmitter 1 output	Output
9	Transmitter 3 output	Channel 3
10	Transmitter 3 +U	
11	Receiver 3 +U	
12	Receiver 3 input	Input
13	Transmitter 4 output	Channel 4
14	Transmitter 4 +U	
15	Receiver 4 +U	
16	Receiver 4 input	Input

Matching System Components

	SLA12/115	Safety thru-beam sensor
	SLA12/124	Safety thru-beam sensor
	SLA29/105/106	Safety thru-beam sensor
	SLA29/116	Safety thru-beam sensor
	SLA29/35/73c R=65m	Safety thru-beam sensor
	SLA29/73c	Safety thru-beam sensor
	SLA29/35/116 R=65m	Safety thru-beam sensor
	SLA12-LAS-T/124	Safety thru-beam sensor with laser
	SLA12-LAS-T/35/124	Safety thru-beam sensor with laser

Release date: 2023-02-15 Date of issue: 2023-02-15 Filename: 180323_eng.pdf

Function

The evaluation system SB4 is an ESPE of type 4 (EN 61496-1 or IEC 61496-1) or category 4 (EN 954-1). This system is also designed and tested according to IEC 61508. It meets the requirements for the SIL3.

The operating instructions supplied with the device must be observed for planning, installation and operation.

A maximum of 4 safety light barriers can be connected to the evaluation device. Instead of the light barriers, other contact safety equipment can be connected.

Operating modes

By default, the restart interlock is activated.

Each assembly contains DIP switches for selecting the functions. For selecting functions, 2 selector switches must always be actuated.

Switches on the first assembly:

switch	Position	Operation type
1 and 3	OFF	Without restart interlock (restart, RI)
	ON	With restart interlock (restart, RI)
2 and 4	OFF	Without relay monitor (RM)
	ON	With relay monitor (RM)

Switches on the second assembly:

switch	Position	Operation type
1 and 3	OFF	No antivalent evaluation
	ON	Antivalent evaluation active
2 and 4	OFF	No simultaneousness evaluation
	ON	Simultaneousness evaluation active

Displays

The OSSD-R/supply module on position 1 has a red/green LED for indicating the OSSD on/off statuses, a yellow LED for the start-ready status and a 7 segment display for system diagnosis.

The 7 segment display indicates the status and the error codes of the system.

Display	7 segment display
1	DIP switch position does not match
2	Incorrect configuration
3	Time-out at one or more muting sensors
4	Transmitter error
6	Muting lamp error
7	Simultaneousness monitoring error
8	Receiver error
9	Error at sensor channel
E	System error
F	Relay monitor error
H	Selection chain error
U	Low voltage or voltage surge detected

Release date: 2023-02-15 Date of issue: 2023-02-15 Filename: 180323_eng.pdf