


Ind. angular measuring system

PMI360DV-F130-3E2-V15

- 3 configurable switching frames



Dimensions

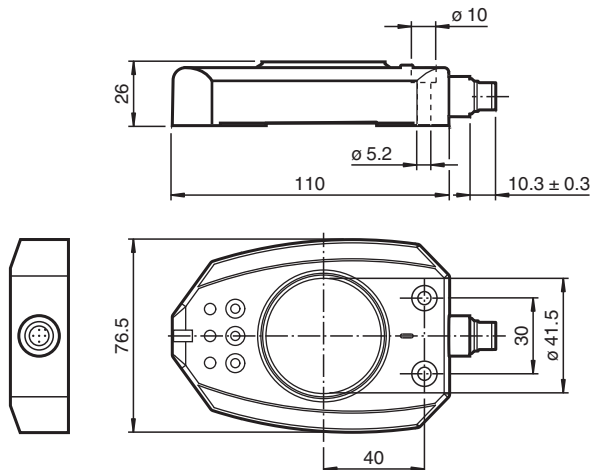

Technical Data

General specifications		
Measurement range		max. 360° min. 5°
Adjustment range		3 switch frames programmable , min. 5°, max. 360°
Rotational speed		max. 100 min ⁻¹
Nominal ratings		
Operating voltage	U _B	18 ... 30 V DC
Reverse polarity protection		reverse polarity protected
Repeat accuracy	R	± 0.25 °
Resolution		0.2 °
Temperature drift		0.02 ° / °C (-25 °C ... 70 °C)
No-load supply current	I ₀	≤ 45 mA
Time delay before availability	t _v	1 s
Functional safety related parameters		
MTTF _d		450 a
Mission Time (T _M)		20 a
Diagnostic Coverage (DC)		0 %

Release date: 2022-05-17 Date of issue: 2022-05-17 Filename: 215314_eng.pdf

Refer to "General Notes Relating to Pepperl+Fuchs Product Information".

Pepperl+Fuchs Group
www.pepperl-fuchs.com

USA: +1 330 486 0001
fa-info@us.pepperl-fuchs.com

Germany: +49 621 776 1111
fa-info@de.pepperl-fuchs.com


Singapore: +65 6779 9091
fa-info@sg.pepperl-fuchs.com

 PEPPERL+FUCHS


Technical Data

Indicators/operating means	
LED yellow 1	switching state, Switching output 1
LED yellow 2	switching state, Switching output 2
LED yellow 3	switching state, Switching output 3
LED PWR/ERR	Status display LED, green/red (Power on / missing actuator / keylock)
Switching output	
Output type	3 switch outputs PNP, NO , reverse polarity protected , short-circuit protected , programmable
Operating current	$I_L \leq 100 \text{ mA}$
Switching hysteresis	1 °
Voltage drop	$\leq 3 \text{ V}$
Short-circuit protection	pulsing
Compliance with standards and directives	
Standard conformity	
Standards	EN 60947-5-2:2007 EN 60947-5-2/A1:2012 IEC 60947-5-2:2007 IEC 60947-5-2 AMD 1:2012
Approvals and certificates	
UL approval	cULus Listed, General Purpose, Class 2 Power Source
CCC approval	CCC approval / marking not required for products rated $\leq 36 \text{ V}$
Ambient conditions	
Ambient temperature	-25 ... 70 °C (-13 ... 158 °F)
Mechanical specifications	
Connection type	5-pin, M12 x 1 connector
Degree of protection	IP67
Material	
Housing	PBT
Target	mild steel, e. g. 1.0037, SR235JR (formerly St37-2)
Mass	180 g

Connection



Connection Assignment






Release date: 2022-05-17 Date of issue: 2022-05-17 Filename: 215314_eng.pdf

Connection Assignment

Wire colors in accordance with EN 60947-5-2

1	BN	(brown)
2	WH	(white)
3	BU	(blue)
4	BK	(black)
5	GY	(gray)

Accessories


	BT-F130-A	Actuator for F130 series
	V15-G-2M-PVC	Female cordset single-ended M12 straight A-coded, 5-pin, PVC cable grey
	V15-W-2M-PVC	Female cordset single-ended M12 angled A-coded, 5-pin, PVC cable grey

Additional Information

Using a different actuating element

You can use a different actuator instead of the BT-F130-A actuator provided, which must be positioned centrally in the sensor opening. When using a different actuating element, the element must fulfill all requirements relating to the material, dimensions and distance to the sensitive surface on the sensors (see table). Failing to fulfill all of these requirements may reduce the accuracy/resolution of the sensor or even cause the sensor to stop functioning.

Dimensions when using a different actuating element

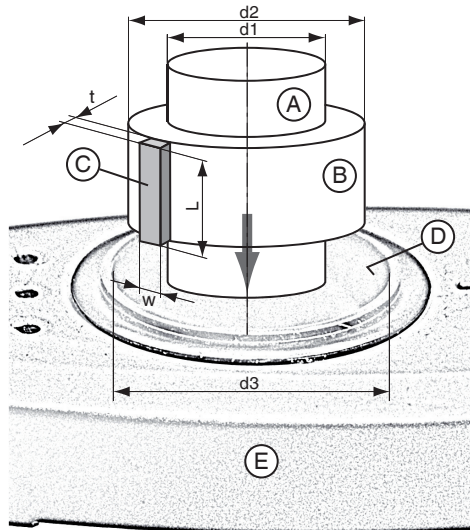

- A Drive shaft
- B Insulation ring made from non-conductive material
- C Separate actuator (L ≥ 23 mm)
- D Sensitive surface on the sensors (black, cylindrical inner surface)
- E Sensor



Actuator (C) can be placed on the insulating ring made from non-conductive material (B) or inserted in this ring.

Dimension	
t	2 mm
w	7.5 mm
L	≥ 23mm
d1	Depending on the drive shaft material S235JR+AR (previously St37-2): max. 19 mm Stainless steel 1.4435 / AISI 316L (V4A): max. 21 mm Stainless steel 1.4305 / AISI 303 (V2A): max. 23 mm
d2	Select so that the distance between the edges of the actuator and the sensitive surface on the sensor is 1 ... 2 mm.
d3	41.5 mm
Actuator material	Mild steel such as S235JR+AR (previously St37-2)

Release date: 2022-05-17 Date of issue: 2022-05-17 Filename: 215314_eng.pdf